



INSTALLATION INSTRUCTIONS TGL AIR LINEAR HIGH BAY

Application and safety notes

- Carefully read and follow all warnings and instructions before installing or servicing the luminaire.
- The installation should be done by an individual familiar with the construction and operation of the luminaire.
- The installation of this luminaire must be in accordance with national and local building and electrical codes.
- The product must not be damaged or operated in a damaged condition.
- This luminaire must be directly wired on line. Any ballast or other power device previously used with the replaced luminaire must be removed.
- Between the luminaire and any possibly flammable material must be an appropriate safety space (at least 20cm).
- The luminaire must not be covered with heat insulating materials.
- Always provide proper ventilation around the luminaire and do not exceed the maximum ambient temperature.
- Compared to traditional lights the characteristic light distribution of this LED luminaire may differ. In order to be sure to meet your lighting requirements a photometric check of the installation is recommended.

Maintenance

- To avoid injuries, disconnect power to the light and allow the unit to cool down before performing maintenance.
- ⚠ **Warning:** No user serviceable parts inside. Risk of electric shock. Removal of the lens will void the warranty.
- Perform visual, mechanical and electrical inspections on a regular basis. We recommend routine checks to be made on an annual basis. Frequency of use and environment should determine this.
- The lens should be cleaned periodically as needed to ensure continued photometric performance. Clean the lens with a damp, non-abrasive, lint-free cloth. If not sufficient, use mild soap or a liquid cleaner. Do not use an abrasive, strong alkaline or acid cleaner as damage may occur.
- Inspect the cooling surfaces and fins on the luminaire to ensure that they are free of any obstructions or contamination (i.e. excessive dust build-up). Clean with a non-abrasive cloth if needed.

All statements, technical information and recommendations contained in this document are based on information and tests we believe to be reliable. The accuracy or completeness thereof is not guaranteed. We reserve the right to revise or update this document without notice. Since the conditions of use are outside our control, the purchaser should determine the suitability of the product for its intended use and assumes all risk and liability whatsoever in connection therewith.




Installation Instructions for suspended use


- The modification must be done by qualified personal
- Before you start make sure that the supply voltage is disconnected so you can work safely
- Drill two 10mm holes in the ceiling at the position you want the light to be installed and put in the screws
- Place the hanging ropes on the clivers of the expansion screws and adjust the ropes to the suitable length
- Hang the luminaire on the hooks of the ropes make sure the safety clip is completely closed
- Connect the driver to the power line.




Adjust the spacing between the holes according to your installation situation

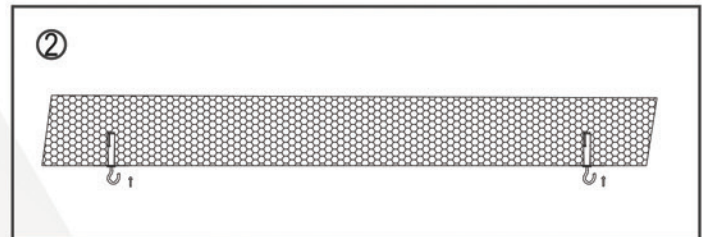

Fix the expansions screws in the wholes you prepared

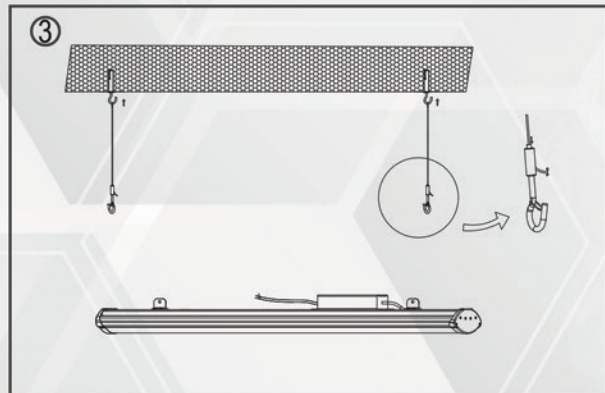

Connect the fixture to the rope and make sure the safety clip is closed

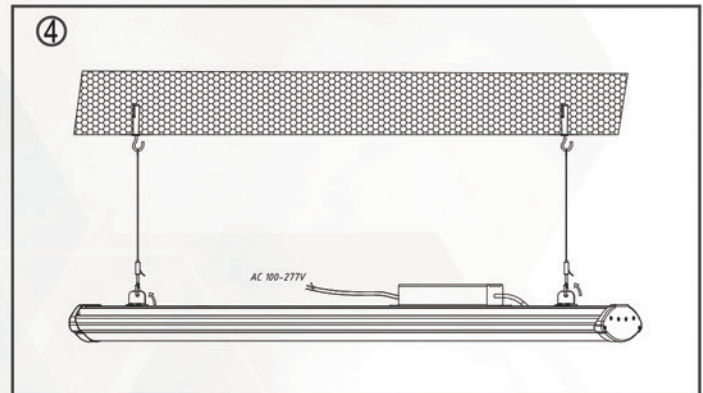


L – Brown N – Neutral PE – Green-Yellow




Installation Instructions for Surface mounting


- The modification must be done by qualified personal
- Before you start make sure that the supply voltage is disconnected so you can work safely
- Drill two 10mm holes in the ceiling at the position you want the light to be installed and put in the screws
- Hang the luminaire on the clivers of the expansion screws
- Connect the driver to the power line.

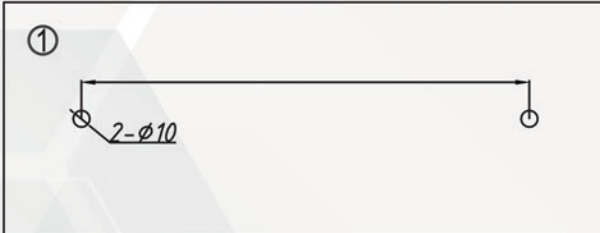


Adjust the spacing between the holes according to your installation situation

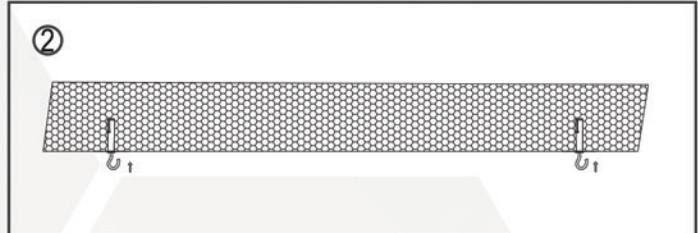

Fix the expansions screws in the wholes you prepared

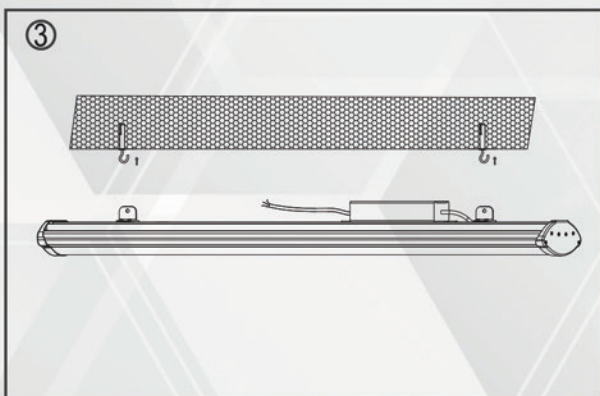

Connect the fixture to the rope and make sure the safety clip is closed

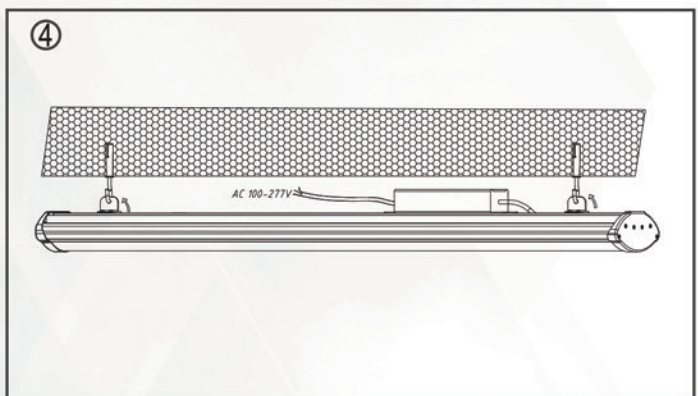

L – Brown N – Neutral PE – Green-Yellow